


Why Strath Oykel Wind Farm

PEAT

Following further site investigation, peat surveys were completed with results shown below. As shown, the majority of the site comprises peat which is less than 1m deep. When considering constraints across the site, areas of peat greater than 1m have been avoided and turbines have not been placed in these locations.

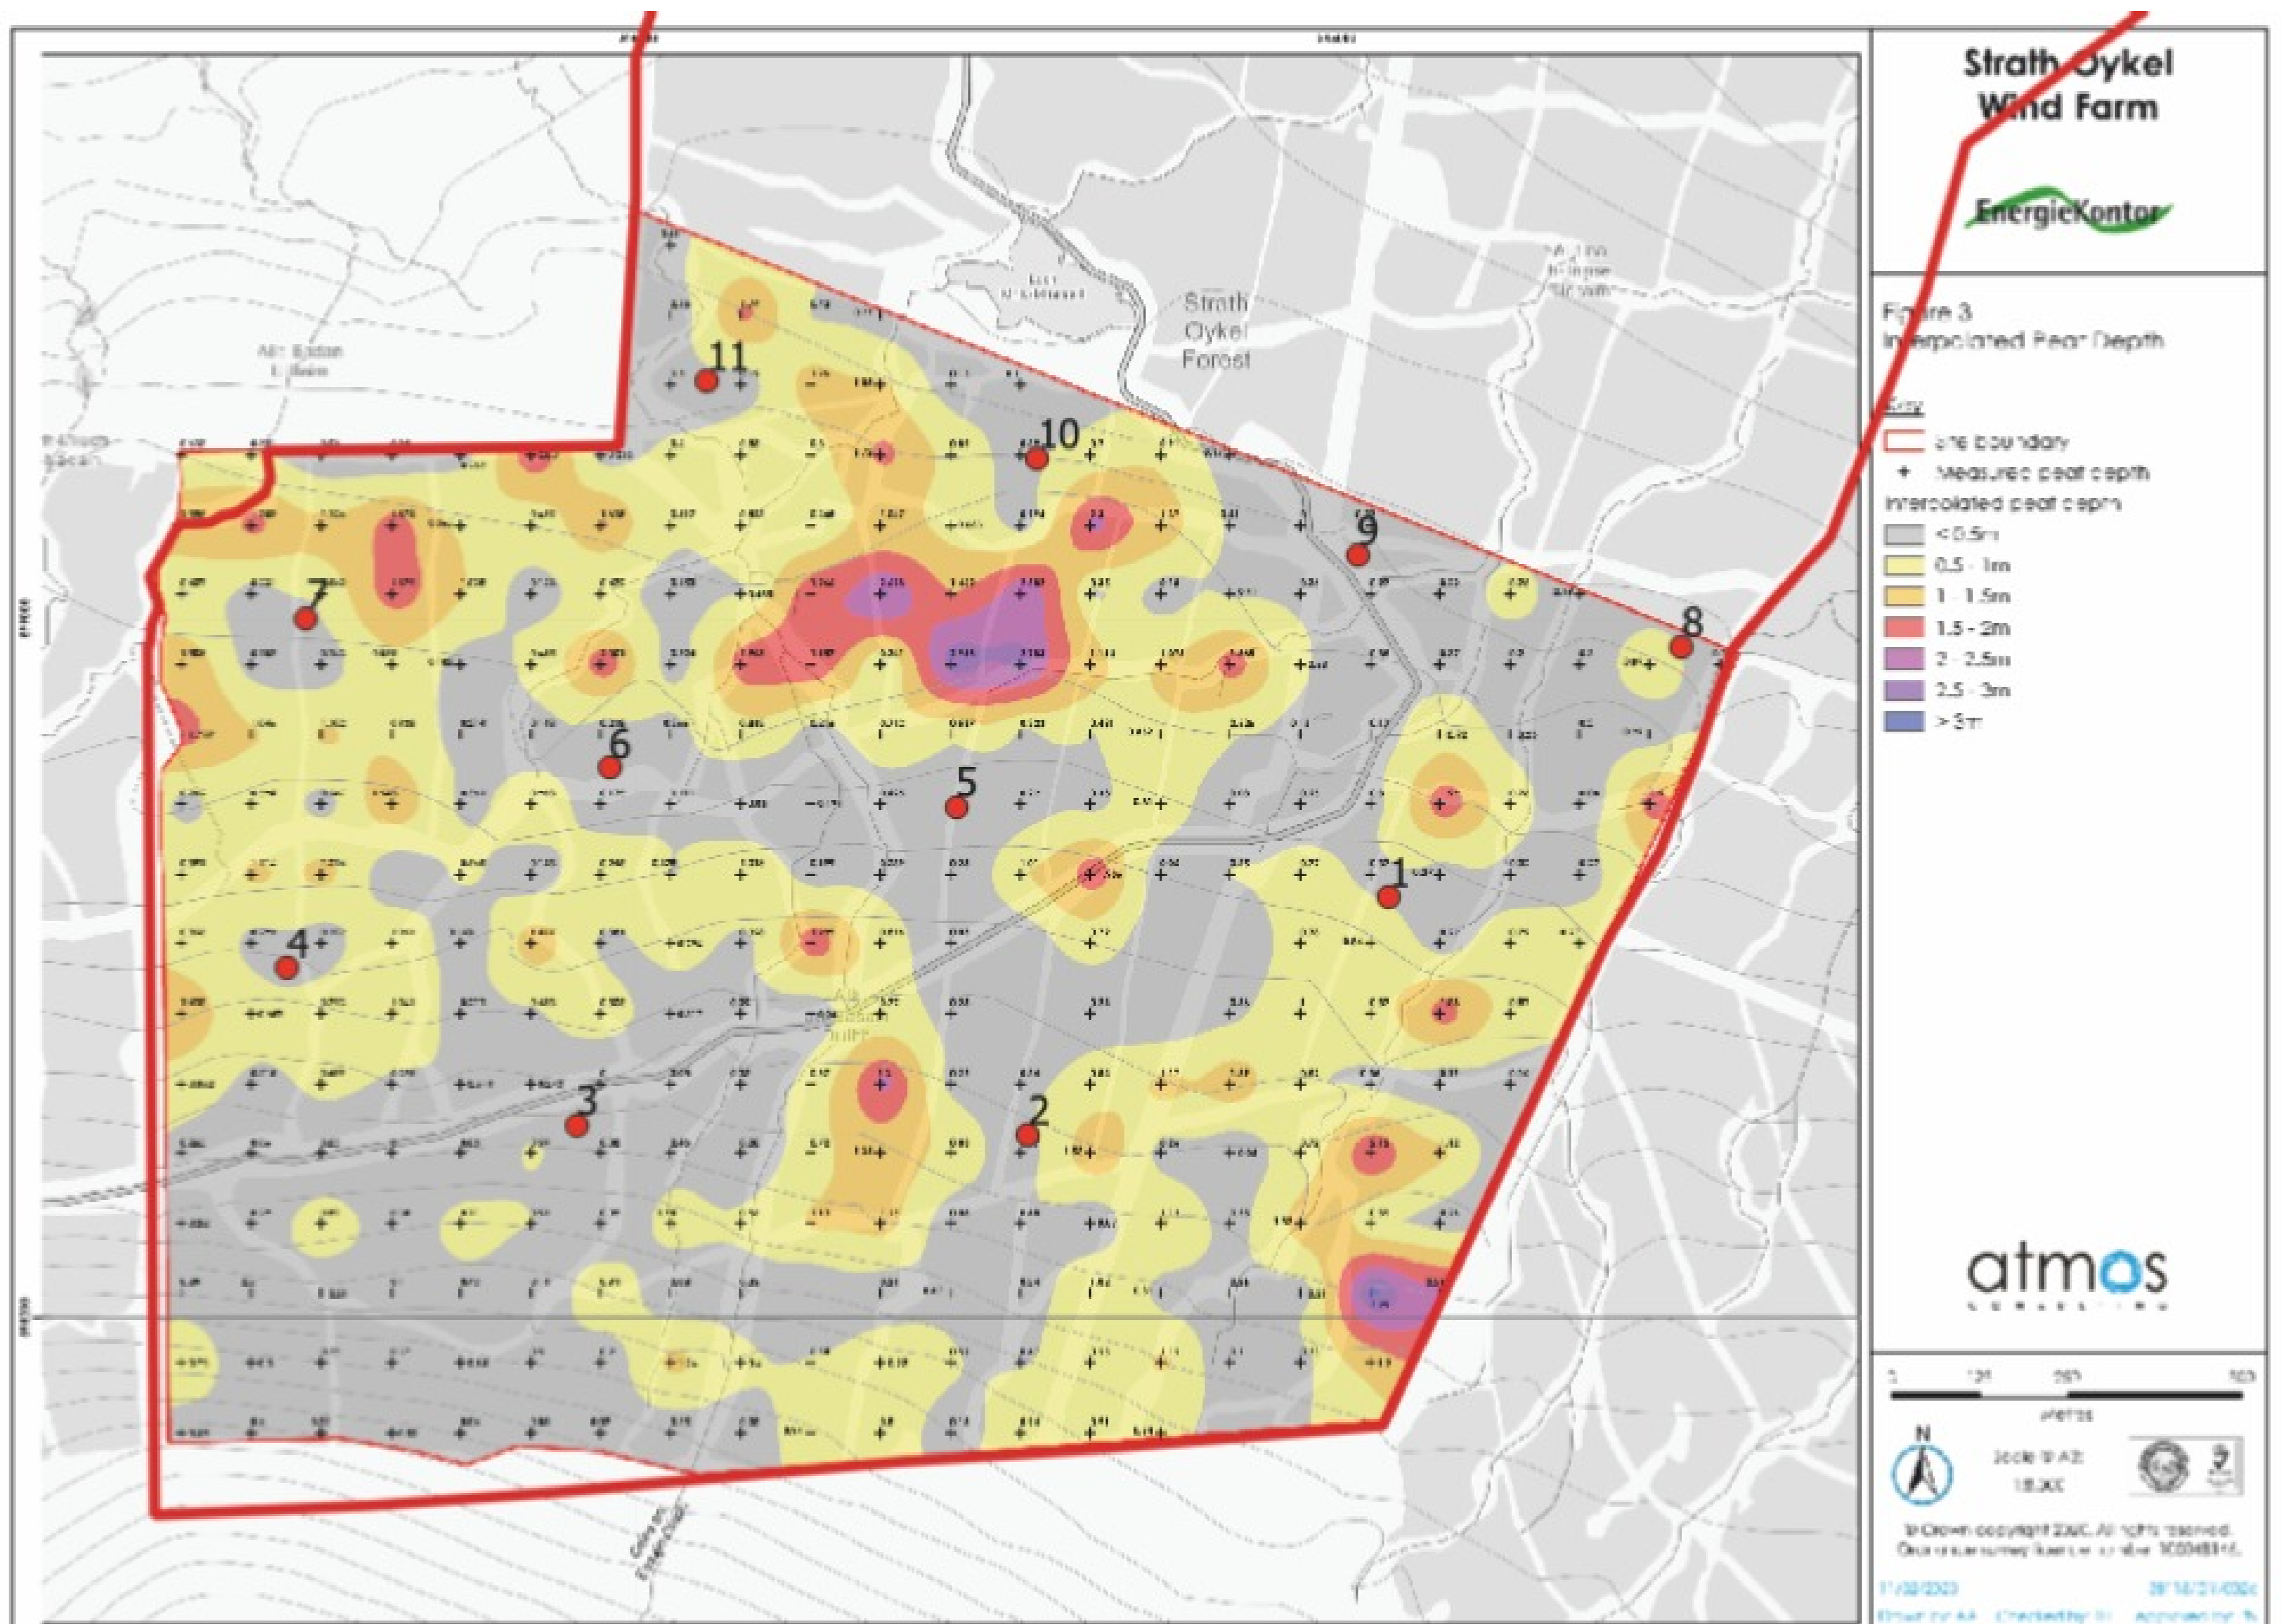

We consider that Strath Oykel is in a suitable location in terms of known constraints. The on-site infrastructure is being designed around identified constraints and we are continuing to engage with NatureScot and SEPA on peat across the site in terms of methodology and assessment.